


ELEVATION

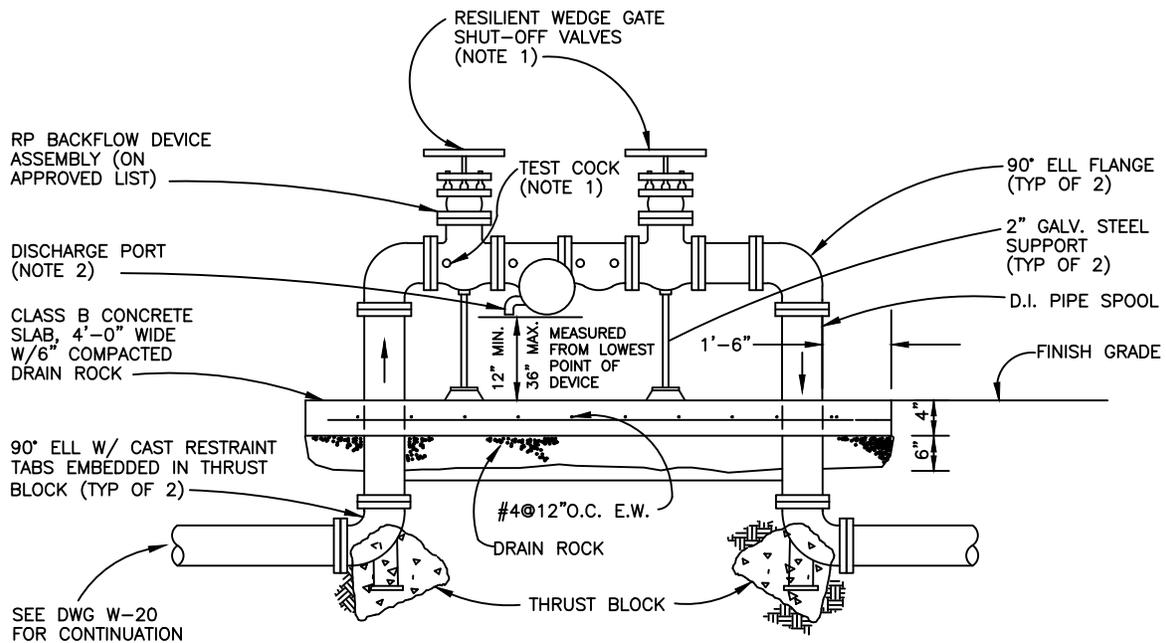

DETAIL A

NOTES:

1. TEST COCKS AND SHUT-OFF VALVES MUST BE SUPPLIED AS SHOWN.
2. DISCHARGE PORT MUST BE KEPT CLEAR OF OBSTRUCTION AT ALL TIMES.
3. 2 1/2 THRU 10" MUST HAVE RESILIENT SEAT WEDGE SHUT-OFF VALVES.
4. DEVICE SHALL BE TESTED BY CERTIFIED TESTER. TEST REPORT SHALL BE SUBMITTED TO DSRSD.
5. PROTECTIVE ENCLOSURE NOT SHOWN. REFER TO SECTION II-B2-7 AND DRAWING W-25 FOR ENCLOSURE REQUIREMENTS.
6. ALL BOLTS SHALL BE STAINLESS STEEL TYPE 316, ANTI-SEIZE LUBRICANT SHALL BE APPLIED TO BOLT THREADS. POLYWRAP ALL FERROUS PIPE AND FITTINGS.
7. CONCRETE PADS SHALL BE FORMED TO NEAREST CURB OR SIDEWALK ELEVATION WITH A FINE BROOM FINISH.
8. INLET AND OUTLET PIPE RISERS SHALL BE WRAPPED WITH 10 MIL PVC TAPE OR FOAM CLOSET FLANGE WRAP WITHIN CONCRETE PAD.

Dublin San Ramon Services District

REVISION DATE
JUN 2025

2 1/2" TO 10" REDUCED PRESSURE BACKFLOW
PREVENTION DEVICE

REVISED BY
RM

SIGNED COPY ON FILE AT DISTRICT OFFICE

DRAWING
W-22